



ITT

Wastewater

Wastewater Technical Manual

Goulds Pumps

www.goulds.com

Red Jacket Water Products

www.redjacketwaterproducts.com

Bell & Gossett

www.bellgossett.com

CentriPro

www.centripro.com

Goulds Pumps, Red Jacket Water Products, Bell & Gossett and CentriPro are brands of ITT Corporation.

Engineered for life



ITT

Wastewater

Index

FRICTION LOSS

| | |
|----------------|---|
| Plastic..... | 3 |
| Steel | 4 |
| Fittings | 5 |

PIPE VOLUME AND VELOCITY

| | |
|----------------------------------------------|---|
| Storage of Water in Various Size Pipes | 5 |
| Minimum Flow to Maintain 2 Ft./Sec..... | 5 |

SEWAGE PUMP

| | |
|---------------------------|---|
| Sizing and Selection..... | 6 |
|---------------------------|---|

ELECTRICAL DATA

| | |
|---------------------------------------------|----|
| Agency Listing / Removing Plug Letters..... | 10 |
| Transformer Sizes | 10 |
| Three Phase Unbalance..... | 11 |
| NEMA Panel Enclosures | 12 |

DETERMINING FLOW RATES

| | |
|--------------------------------------------|----|
| Full Pipe Flow | 13 |
| Pipe Not Running Full | 13 |
| Discharge Rate in Gallons per Minute | 13 |

TERMS AND USABLE FORMULAS

| | |
|---------------------|----|
| Definitions | 14 |
| Basic Formulas..... | 14 |

TYPICAL INSTALLATIONS


| | |
|--------------------------|----|
| Sump..... | 16 |
| Effluent and Sewage..... | 17 |

VARIABLE SPEED DRIVES

| | |
|-----------------------|----|
| Wastewater Pumps..... | 18 |
|-----------------------|----|

PANEL LAYOUTS AND WIRING DIAGRAMS

| | |
|------------------------------------------|----|
| Duplex Single Phase | 19 |
| Duplex Three Phase | 21 |
| Simplex Single Phase | 23 |
| Switch Diagrams..... | 25 |
| Sewage Control Panels and Switches | 26 |




ITT

Wastewater

Friction Loss

PLASTIC PIPE: FRICTION LOSS (IN FEET OF HEAD) PER 100 FT.

| GPM | GPH | 3/8" | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" | 2 1/2" | 3" | 4" | 6" | 8" | 10" |
|------|--------|-------|-------|-------|-------|--------|--------|-------|--------|------|------|------|------|-----|
| | | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. |
| 1 | 60 | 4.25 | 1.38 | .356 | .11 | | | | | | | | | |
| 2 | 120 | 15.13 | 4.83 | 1.21 | .38 | .10 | | | | | | | | |
| 3 | 180 | 31.97 | 9.96 | 2.51 | .77 | .21 | .10 | | | | | | | |
| 4 | 240 | 54.97 | 17.07 | 4.21 | 1.30 | .35 | .16 | | | | | | | |
| 5 | 300 | 84.41 | 25.76 | 6.33 | 1.92 | .51 | .24 | | | | | | | |
| 6 | 360 | | 36.34 | 8.83 | 2.69 | .71 | .33 | .10 | | | | | | |
| 8 | 480 | | 63.71 | 15.18 | 4.58 | 1.19 | .55 | .17 | | | | | | |
| 10 | 600 | | 97.52 | 25.98 | 6.88 | 1.78 | .83 | .25 | .11 | | | | | |
| 15 | 900 | | | 49.68 | 14.63 | 3.75 | 1.74 | .52 | .22 | | | | | |
| 20 | 1,200 | | | 86.94 | 25.07 | 6.39 | 2.94 | .86 | .36 | .13 | | | | |
| 25 | 1,500 | | | | 38.41 | 9.71 | 4.44 | 1.29 | .54 | .19 | | | | |
| 30 | 1,800 | | | | | 13.62 | 6.26 | 1.81 | .75 | .26 | | | | |
| 35 | 2,100 | | | | | 18.17 | 8.37 | 2.42 | 1.00 | .35 | .09 | | | |
| 40 | 2,400 | | | | | 23.55 | 10.70 | 3.11 | 1.28 | .44 | .12 | | | |
| 45 | 2,700 | | | | | 29.44 | 13.46 | 3.84 | 1.54 | .55 | .15 | | | |
| 50 | 3,000 | | | | | | 16.45 | 4.67 | 1.93 | .66 | .17 | | | |
| 60 | 3,600 | | | | | | 23.48 | 6.60 | 2.71 | .93 | .25 | | | |
| 70 | 4,200 | | | | | | | 8.83 | 3.66 | 1.24 | .33 | | | |
| 80 | 4,800 | | | | | | | 11.43 | 4.67 | 1.58 | .41 | | | |
| 90 | 5,400 | | | | | | | 14.26 | 5.82 | 1.98 | .52 | | | |
| 100 | 6,000 | | | | | | | | 7.11 | 2.42 | .63 | .08 | | |
| 125 | 7,500 | | | | | | | | 10.83 | 3.80 | .95 | .13 | | |
| 150 | 9,000 | | | | | | | | | 5.15 | 1.33 | .18 | | |
| 175 | 10,500 | | | | | | | | | 6.90 | 1.78 | .23 | | |
| 200 | 12,000 | | | | | | | | | 8.90 | 2.27 | .30 | | |
| 250 | 15,000 | | | | | | | | | | 3.36 | .45 | .12 | |
| 300 | 18,000 | | | | | | | | | | 4.85 | .63 | .17 | |
| 350 | 21,000 | | | | | | | | | | 6.53 | .84 | .22 | |
| 400 | 24,000 | | | | | | | | | | | 1.08 | .28 | |
| 500 | 30,000 | | | | | | | | | | | 1.66 | .42 | .14 |
| 550 | 33,000 | | | | | | | | | | | 1.98 | .50 | .16 |
| 600 | 36,000 | | | | | | | | | | | 2.35 | .59 | .19 |
| 700 | 42,000 | | | | | | | | | | | | .79 | .26 |
| 800 | 48,000 | | | | | | | | | | | | 1.02 | .33 |
| 900 | 54,000 | | | | | | | | | | | | 1.27 | .41 |
| 950 | 57,000 | | | | | | | | | | | | | .46 |
| 1000 | 60,000 | | | | | | | | | | | | | .50 |



ITT

Wastewater

Friction Loss

STEEL PIPE: FRICTION LOSS (IN FEET OF HEAD) PER 100 FT.

| GPM | GPH | 3/8" | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" | 2 1/2" | 3" | 4" | 5" | 6" | 8" | 10" |
|------|--------|-------|-------|-------|-------|--------|--------|-------|--------|--------|-------|-------|------|-------|-------|
| | | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. | ft. |
| 1 | 60 | 4.30 | 1.86 | .26 | | | | | | | | | | | |
| 2 | 120 | 15.00 | 4.78 | 1.21 | .38 | | | | | | | | | | |
| 3 | 180 | 31.80 | 10.00 | 2.50 | .77 | | | | | | | | | | |
| 4 | 240 | 54.90 | 17.10 | 4.21 | 1.30 | .34 | | | | | | | | | |
| 5 | 300 | 83.50 | 25.80 | 6.32 | 1.93 | .51 | .24 | | | | | | | | |
| 6 | 360 | | 36.50 | 8.87 | 2.68 | .70 | .33 | .10 | | | | | | | |
| 7 | 420 | | 48.70 | 11.80 | 3.56 | .93 | .44 | .13 | | | | | | | |
| 8 | 480 | | 62.70 | 15.00 | 4.54 | 1.18 | .56 | .17 | | | | | | | |
| 9 | 540 | | | 18.80 | 5.65 | 1.46 | .69 | .21 | | | | | | | |
| 10 | 600 | | | 23.00 | 6.86 | 1.77 | .83 | .25 | .11 | .04 | | | | | |
| 12 | 720 | | | 32.60 | 9.62 | 2.48 | 1.16 | .34 | .15 | .05 | | | | | |
| 15 | 900 | | | 49.70 | 14.70 | 3.74 | 1.75 | .52 | .22 | .08 | | | | | |
| 20 | 1,200 | | | 86.10 | 25.10 | 6.34 | 2.94 | .87 | .36 | .13 | | | | | |
| 25 | 1,500 | | | | 38.60 | 9.65 | 4.48 | 1.30 | .54 | .19 | | | | | |
| 30 | 1,800 | | | | 54.60 | 13.60 | 6.26 | 1.82 | .75 | .26 | | | | | |
| 35 | 2,100 | | | | 73.40 | 18.20 | 8.37 | 2.42 | 1.00 | .35 | | | | | |
| 40 | 2,400 | | | | 95.00 | 23.50 | 10.79 | 3.10 | 1.28 | .44 | | | | | |
| 45 | 2,700 | | | | | 30.70 | 13.45 | 3.85 | 1.60 | .55 | | | | | |
| 70 | 4,200 | | | | | 68.80 | 31.30 | 8.86 | 3.63 | 1.22 | .35 | | | | |
| 100 | 6,000 | | | | | | 62.20 | 17.40 | 7.11 | 2.39 | .63 | | | | |
| 150 | 9,000 | | | | | | | 38.00 | 15.40 | 5.14 | 1.32 | | | | |
| 200 | 12,000 | | | | | | | 66.30 | 26.70 | 8.90 | 2.27 | .736 | .30 | .08 | |
| 250 | 15,000 | | | | | | | 90.70 | 42.80 | 14.10 | 3.60 | 1.20 | .49 | .13 | |
| 300 | 18,000 | | | | | | | | 58.50 | 19.20 | 4.89 | 1.58 | .64 | .16 | .0542 |
| 350 | 21,000 | | | | | | | | 79.20 | 26.90 | 6.72 | 2.18 | .88 | .23 | .0719 |
| 400 | 24,000 | | | | | | | | 103.00 | 33.90 | 8.47 | 2.72 | 1.09 | .279 | .0917 |
| 450 | 27,000 | | | | | | | | 130.00 | 42.75 | 10.65 | 3.47 | 1.36 | .348 | .114 |
| 500 | 30,000 | | | | | | | | 160.00 | 52.50 | 13.00 | 4.16 | 1.66 | .424 | .138 |
| 550 | 33,000 | | | | | | | | 193.00 | 63.20 | 15.70 | 4.98 | 1.99 | .507 | .164 |
| 600 | 36,000 | | | | | | | | 230.00 | 74.80 | 18.60 | 5.88 | 2.34 | .597 | .192 |
| 650 | 39,000 | | | | | | | | | 87.50 | 21.70 | 6.87 | 2.73 | .694 | .224 |
| 700 | 42,000 | | | | | | | | | 101.00 | 25.00 | 7.93 | 3.13 | .797 | .256 |
| 750 | 45,000 | | | | | | | | | 116.00 | 28.60 | 9.05 | 3.57 | .907 | .291 |
| 800 | 48,000 | | | | | | | | | 131.00 | 32.40 | 10.22 | 4.03 | 1.02 | .328 |
| 850 | 51,000 | | | | | | | | | 148.00 | 36.50 | 11.50 | 4.53 | 1.147 | .368 |
| 900 | 54,000 | | | | | | | | | 165.00 | 40.80 | 12.90 | 5.05 | 1.27 | .410 |
| 950 | 57,000 | | | | | | | | | 184.00 | 45.30 | 14.30 | 5.60 | 1.41 | .455 |
| 1000 | 60,000 | | | | | | | | | 204.00 | 50.20 | 15.80 | 6.17 | 1.56 | .500 |



ITT

Wastewater

Friction Loss

EQUIVALENT NUMBER OF FEET STRAIGHT PIPE FOR DIFFERENT FITTINGS

| Size of fittings, Inches | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" | 2 1/2" | 3" | 4" | 5" | 6" | 8" | 10" |
|---------------------------------------------|------|------|------|--------|--------|------|--------|------|-------|-------|-------|-------|-----|
| 90° Ell | 1.5 | 2.0 | 2.7 | 3.5 | 4.3 | 5.5 | 6.5 | 8.0 | 10.0 | 14.0 | 15 | 20 | 25 |
| 45° Ell | 0.8 | 1.0 | 1.3 | 1.7 | 2.0 | 2.5 | 3.0 | 3.8 | 5.0 | 6.3 | 7.1 | 9.4 | 12 |
| Long Sweep Ell | 1.0 | 1.4 | 1.7 | 2.3 | 2.7 | 3.5 | 4.2 | 5.2 | 7.0 | 9.0 | 11.0 | 14.0 | |
| Close Return Bend | 3.6 | 5.0 | 6.0 | 8.3 | 10.0 | 13.0 | 15.0 | 18.0 | 24.0 | 31.0 | 37.0 | 39.0 | |
| Tee-Straight Run | 1 | 2 | 2 | 3 | 3 | 4 | 5 | | | | | | |
| Tee-Side Inlet or Outlet or Pitless Adapter | 3.3 | 4.5 | 5.7 | 7.6 | 9.0 | 12.0 | 14.0 | 17.0 | 22.0 | 27.0 | 31.0 | 40.0 | |
| Ball or Globe Valve Open | 17.0 | 22.0 | 27.0 | 36.0 | 43.0 | 55.0 | 67.0 | 82.0 | 110.0 | 140.0 | 160.0 | 220.0 | |
| Angle Valve Open | 8.4 | 12.0 | 15.0 | 18.0 | 22.0 | 28.0 | 33.0 | 42.0 | 58.0 | 70.0 | 83.0 | 110.0 | |
| Gate Valve-Fully Open | 0.4 | 0.5 | 0.6 | 0.8 | 1.0 | 1.2 | 1.4 | 1.7 | 2.3 | 2.9 | 3.5 | 4.5 | |
| Check Valve (Swing) | 4 | 5 | 7 | 9 | 11 | 13 | 16 | 20 | 26 | 33 | 39 | 52 | 65 |
| In Line Check Valve (Spring) or Foot Valve | 4 | 6 | 8 | 12 | 14 | 19 | 23 | 32 | 43 | 58 | | | |

Example:

(A) 100 ft. of 2" plastic pipe with one (1) 90° elbow and one (1) swing check valve.

90° elbow – equivalent to 5.5 ft. of straight pipe
 Swing check – equivalent to 13.0 ft. of straight pipe
 100 ft. of pipe – equivalent to 100 ft. of straight pipe
 118.5 ft. = Total equivalent pipe

Figure friction loss for 118.5 ft. of pipe.

(B) Assume flow to be 80 GPM through 2" plastic pipe.

- Friction loss table shows 11.43 ft. loss per 100 ft. of pipe.
- In step (A) above we have determined total ft. of pipe to be 118.5 ft.
- Convert 118.5 ft. to percentage $118.5 \div 100 = 1.185$
- Multiply $\begin{matrix} 11.43 \\ \times 1.185 \end{matrix}$

13.54455 or 13.5 ft. = Total friction loss in this system.

PIPE VOLUME AND VELOCITY


Storage of Water in Various Size Pipes

| Pipe Size | Volume in Gallons per Foot | Pipe Size | Volume in Gallons per Foot |
|-----------|----------------------------|-----------|----------------------------|
| 1 1/4" | .06 | 6" | 1.4 |
| 1 1/2" | .09 | 8" | 2.6 |
| 2" | .16 | 10" | 4.07 |
| 3" | .36 | 12" | 5.87 |
| 4" | .652 | | |


Minimum Flow to Maintain 2ft./sec. *Scouring Velocity in Various Pipes

| Pipe Size | Minimum GPM | Pipe Size | Minimum GPM |
|-----------|-------------|-----------|-------------|
| 1 1/4" | 9 | 6" | 180 |
| 1 1/2" | 13 | 8" | 325 |
| 2" | 21 | 10" | 500 |
| 3" | 46 | 12" | 700 |
| 4" | 80 | | |

* Failure to maintain or exceed this velocity will result in clogged pipes. Based on schedule 40 nominal pipe.



Sewage Pump Selection

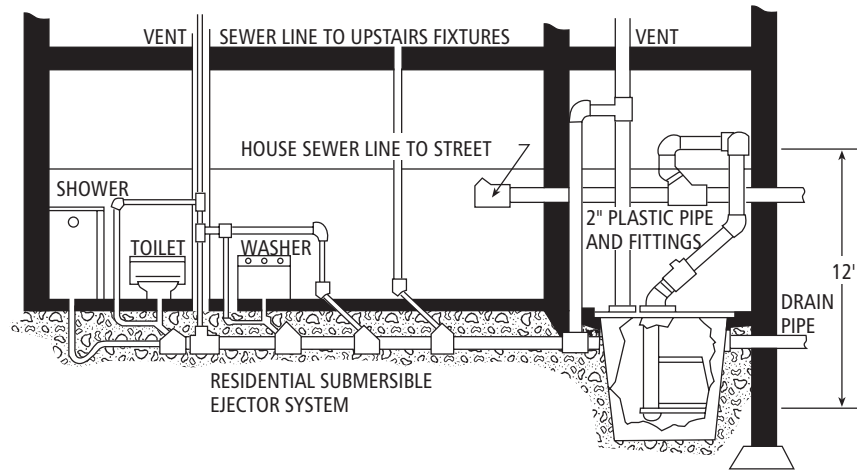

The primary function for which the Submersible Sewage Pump is designed is the handling of sewage and other fluids containing unscreened nonabrasive solids and wastes. In order to insure a maximum of efficiency and dependable performance, careful selection of pump size is necessary. Required pump capacity will depend upon the number and type of fixtures discharging into the sump basin, plus the type of facility served. The fundamentals involved in selecting a pump for a Water System can be applied to selecting a Submersible Sewage Pump. By answering the three (3) questions concerning capacity, suction, and discharge conditions we will know what is required of the pump and be able to select the right pump from the catalog.

1. To simplify the selection of the proper size Submersible Sewage Pump, the general rule is to base the pump capacity on the number of toilets the pump will be serving. This differs from the selection of the proper pump for a Water System in that question 1, "Water Needed" is reversed. How much liquid do we want to dispose of rather than how much do we need? The following chart will help determine pump capacity:

Sewage Selection Table for Residential or Commercial Systems

| Number of Bathrooms | GPM |
|---------------------|-----|
| 1 | 20 |
| 2 | 30 |

The above selection table takes into consideration other fixtures which will drain only water into the sewage basin.

Therefore, pump capacity should not be increased for lavatories, bathtubs, showers, dishwashers, or washing machines. When no toilets are involved in the facility served, for example, a laundromat, the major fixture discharging waste should be considered. In this case, the chart should read "Maximum Number of Washing Machines."

In areas where drain tile from surrounding lawns or fields enters the sump, groundwater seepage can be determined as follows:

- 14 GPM for 1,000 sq. ft. of **sandy soil**
- 8 GPM for 1,000 sq. ft. of **clay soil**

If the calculated groundwater seepage is less than one-fourth of the pump capacity required based on the number of toilets, the pump capacity should not be increased. Any seepage over the allowed one-fourth should be added to the required pump capacity.

2. Since the pump is submerged in the liquid to be pumped, there is no suction lift. Question 2 does NOT become a factor in pump selection.
3. Answering Question 3, discharge conditions is the final step in selecting a Submersible Sewage Pump. Only the vertical distance between the pump and the highest point in the discharge piping, plus friction losses in discharge pipe and fittings affect discharge pressure. (Friction losses can be obtained from the friction table in this Selection Manual.)

Normally service pressure is not a consideration. The total of the vertical distance, plus the friction losses is the required discharge head in feet.



Wastewater Pumps Sizing and Selection

Example: Fig. 1. A two-bathroom home is situated such that the city sewer main is located above the basement drain facilities. Groundwater seepage through drain tile into the sump is estimated at 6 GPM. The vertical distance from the pump to the highest point in the discharge piping is 12 feet.

A pump capable of pumping 30 GPM is required (seepage is less than one-fourth of the pump capacity so it is automatically included). The discharge head must be 12 feet, plus any friction loss in the approximately 15 feet of pipe, 3-90° elbows, 3-45° elbows, and check valve. Assume plastic pipe is used.

- 1. RATE OF FLOW = 30 GPM
Two (2) toilets, includes seepage up to one-fourth of selected _____ pump capacity. 6 GPM is less than the 7.5 GPM allowable so no correction is necessary.
- 2. SUCTION CONDITIONS – Flooded Suction
- 3. DISCHARGE CONDITIONS
Vertical Differential 12.0'
Friction losses @ 30 GPM
15' of 2" pipe (1.8' per 100' of pipe) = .2' F.L.
3-2", 90° elbows = 16.5 equivalent feet
3-2", 45° elbows = 7.5 equivalent feet
1-check valve = 19.0 equivalent feet
Total = 43.0 equivalent feet = .6' F.L.

Total Discharge Head = _____ 12.8'

Referring to the catalog, we find that a 1/3 HP Sewage Pump should be adequate for the job.

The Sewage Selection Chart is to be used as a general guideline in determining pump capacity for larger scale applications.

- Example:**
- (A) 40 unit trailer complex will require 75 GPM pumps, developing the necessary head.
 - (B) 120 home subdivision will require 195 GPM pumps, developing the necessary head.


The chart may be superseded when specific information is given about the installation, when an engineer has determined capacity or when special considerations must be made.


Example: The same conditions as in the previous example exist, except the house is located on a large tract of sandy soil where the groundwater seepage is estimated @ 20 GPM.

- 1. RATE OF FLOW = 30 GPM
Two (2) toilets, includes seepage up to one-fourth of selected pump capacity – 7.5 GPM.
The additional 12.5 GPM (20-7.5) must be added to the required pump capacity – 12.5 GPM
Total = 42.5 GPM
- 2. SUCTION CONDITIONS _____ Flooded Suction
- 3. DISCHARGE CONDITIONS
Vertical Differential – 12.0'
Friction losses @ 42.5 GPM
15' of 2" pipe (3.5' per 100' of pipe) = .5' F.L.
3-2", 90° elbows = 16.5 equivalent feet
3-2", 45° elbows = 7.5 equivalent feet
1-check valve = 19.0 equivalent feet
Total = 43.0 equivalent feet or 1.5' F.L.

Total Discharge Head = 14.0'

Referring again to the catalog, we find that a 1/3 HP Sewage Pump should be adequate for this installation.

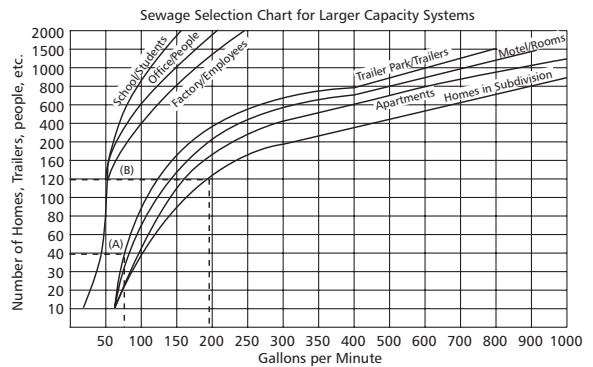




Sewage Pump Selection


Notes:

1. In normal household installation, a **simplex** ejector system will be sufficient. **Duplex** ejector systems are recommended whenever the sewage basin serves as the discharge point for more than six (6) toilets, although each pump must be sized to handle the entire flow in the event of the failure of one pump.
2. When a flapper check valve is installed in a system handling solids, they must not be installed vertically, but in a 45° line or horizontally. This will guard against any solids lodging on top of the valve to prevent it from opening.

3. The sewage basins listed in the catalog are of sufficient size to accommodate the pump(s) for efficient operation. Most household and small commercial applications can be handled with those basins.

Sizing of the basin is important. Too small a basin can cause short cycling of the pump which can lead to motor or electrical damage. A basin which is too large may develop settling areas of waste. Oftentimes a single pump will be used with a duplex sewage basin when additional storage capacity is required. This also enables the customer to install a second pump at a later date with a minimum of additional investment.

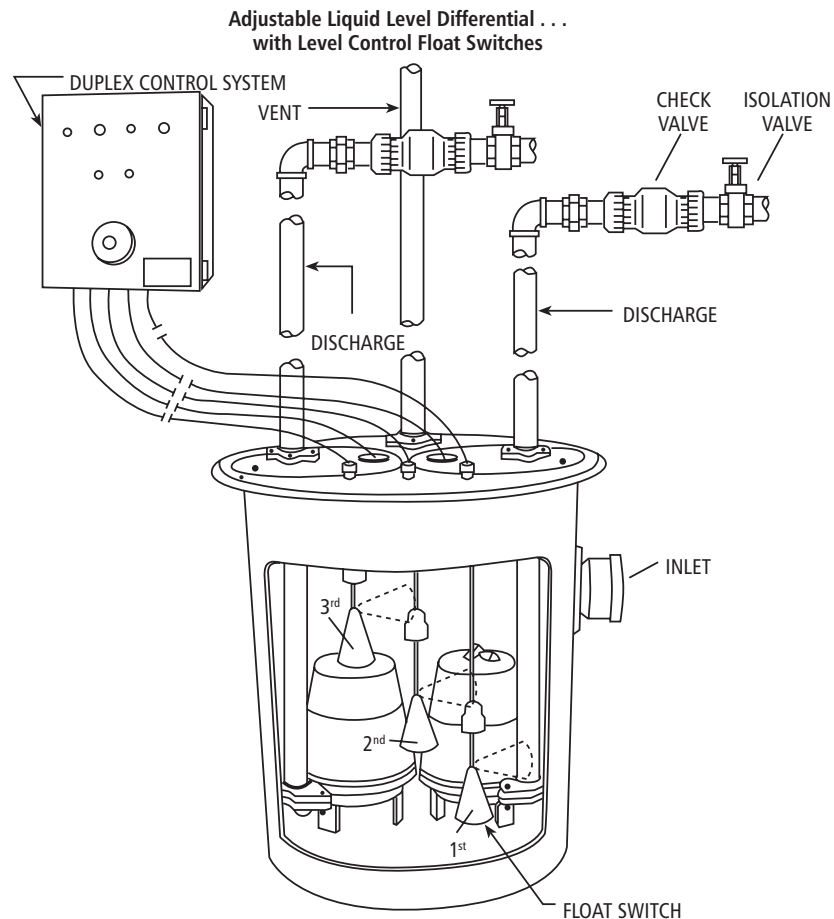



ITT

Wastewater

Electrical Data

AGENCY LISTINGS AND POWER CORD PLUG REMOVAL

Our single-phase sump, effluent and sewage pumps with 115, 208 and 230 volt motors up to and including 1 HP are now built with NEMA three-prong grounding plug power cords. This allows qualified electricians or professional pump installers to easily connect the pumps; according to U.S. National (NEC), Canadian (CSA), state, provincial and local electrical codes, to a properly rated piggyback float switch for automatic operation.

NOTICE: This statement is written for the intent purpose of verifying to electrical inspectors that according to both UL and CSA standards it is allowable to remove the plug ends for direct wiring to a disconnect switch, control panel or hard wired float switch. Removing the plug end does not violate our UL Listing or CSA/CUS certification in any way. Always follow the aforementioned codes when making connections to the bare leads once the plug is removed. Plug removal information and wiring diagrams may be found in the Installation Manual supplied with the pump and in this booklet. Please use this statement in the event an inspector needs written assurance of this policy.


TRANSFORMER SIZES

A full three phase supply is recommended for all three phase motors, consisting of three individual transformers or one three phase transformer. "Open" delta or wye connections using only two transformers can be used, but are more likely to cause problems from current unbalance.

Transformer ratings should be no smaller than listed in the table for supply power to the motor alone.

TRANSFORMER CAPACITY REQUIRED FOR SUBMERSIBLE MOTORS

| Submersible 3Ø Motor HP Rating | Total Effective KVA Required | Smallest KVA Rating – Each Transformer | |
|--------------------------------|------------------------------|----------------------------------------|-----------------------------|
| | | Open WYE DELTA 2 Transformers | WYE or DELTA 3 Transformers |
| 1½ | 3 | 2 | 1 |
| 2 | 4 | 2 | 1½ |
| 3 | 5 | 3 | 2 |
| 5 | 7½ | 5 | 3 |
| 7½ | 10 | 7½ | 5 |
| 10 | 15 | 10 | 5 |
| 15 | 20 | 15 | 7½ |
| 20 | 25 | 15 | 10 |
| 25 | 30 | 20 | 10 |
| 30 | 40 | 25 | 15 |
| 40 | 50 | 30 | 20 |
| 50 | 60 | 35 | 20 |
| 60 | 75 | 40 | 25 |
| 75 | 90 | 50 | 30 |
| 100 | 120 | 65 | 40 |



Application – Three Phase Unbalance

THREE PHASE POWER UNBALANCE

A full three phase supply is recommended for all three phase motors, consisting of three individual transformers or one three phase transformer. So-called "open" delta or wye connections using only two transformers can be used, but are more likely to cause problems, such as poor performance overload tripping or early motor failure due to current unbalance.

Transformer ratings should be no smaller than listed in Table 2 on page 3 for supply power to the motor alone.

Checking and correcting rotation and current unbalance

1. Establish correct motor rotation by running in both directions. Change rotation by exchanging any two of the three motor leads. The rotation that gives the most water flow is always the correct rotation.
2. After correct rotation has been established, check the current in each of the three motor leads and calculate the current unbalance as explained in 3 below.

If the current unbalance is 2% or less, leave the leads as connected.

If the current unbalance is more than 2%, current readings should be checked on each leg using each of the three possible hook-ups. Roll the motor leads across the starter in the same direction to prevent motor reversal.

3. To calculate percent of current unbalance:
 - A. Add the three line amp values together.
 - B. Divide the sum by three, yielding average current.
 - C. Pick the amp value which is furthest from the average current (either high or low).
 - D. Determine the difference between this amp value (furthest from average) and the average.
 - E. Divide the difference by the average.
Multiply the result by 100 to determine percent of unbalance.
4. Current unbalance should not exceed 5% at service factor load or 10% at rated input load. If the unbalance cannot be corrected by rolling leads, the source of the unbalance must be located and corrected. If, on the three possible hook-ups, the leg farthest from the average stays on the same power lead, most of the unbalance is coming from the power source. However, if the reading farthest from average moves with the same motor lead, the primary source of unbalance is on the "motor side" of the starter. In this instance, consider a damaged cable, leaking splice, or faulty motor winding.

Phase designation of leads for CCW rotation viewing shaft end.

To reverse rotation, interchange any two leads.

Phase 1 or "A" – Black Motor Lead or T1

Phase 2 or "B" – White Motor Lead or T2

Phase 3 or "C" – Red Motor Lead or T3

Notice: Phase 1, 2 and 3 may not be L1, L2 and L3.

| | Hookup 1 | | | Hookup 2 | | | Hookup 3 | | |
|-------------------|----------|--------|--------|----------|--------|--------|----------|--------|--------|
| | L1 | L2 | L3 | L1 | L2 | L3 | L1 | L2 | L3 |
| Starter Terminals | ⊥ T | ⊥ T | ⊥ T | ⊥ T | ⊥ T | ⊥ T | ⊥ T | ⊥ T | ⊥ T |
| Motor Leads | T1 | T2 | T3 | T1 | T2 | T3 | T1 | T2 | T3 |
| | R | B | W | W | R | B | B | W | R |
| | T3 | T1 | T2 | T2 | T3 | T1 | T1 | T2 | T3 |

Example:

| | | |
|--------------------|--------------------|--------------------|
| T3-R = 51 amps | T2-W = 50 amps | T1-B = 50 amps |
| T1-B = 46 amps | T3-R = 48 amps | T2-W = 49 amps |
| T2-W = 53 amps | T1-B = 52 amps | T3-R = 51 amps |
| Total = 150 amps | Total = 150 amps | Total = 150 amps |
| ÷ 3 = 50 amps | ÷ 3 = 50 amps | ÷ 3 = 50 amps |
| — 46 = 4 amps | — 48 = 2 amps | — 49 = 1 amp |
| 4 ÷ 50 = .08 or 8% | 2 ÷ 50 = .04 or 4% | 1 ÷ 50 = .02 or 2% |


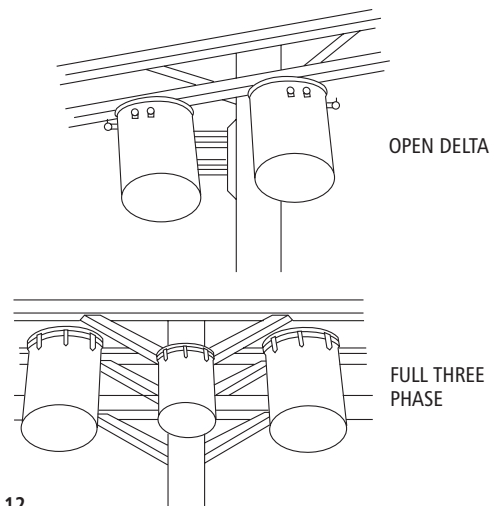


FIGURE 12




Electrical Data

NEMA CONTROL PANEL ENCLOSURES

| Enclosure Rating | Explanation |
|--------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| NEMA 1 ① General Purpose | To prevent accidental contact with enclosed apparatus. Suitable for application indoors where not exposed to unusual service conditions. |
| NEMA 2 Driptight | To prevent accidental contact, and in addition, to exclude falling moisture or dirt. |
| NEMA 3 ① Weatherproof (Weatherproof Resistant) | Protection against specified weather hazards. Suitable for use outdoors. |
| NEMA 3R ① Raintight | Protects against entrance of water from a beating rain. Suitable for general outdoor application not requiring sleetproof. |
| NEMA 4 ① Watertight | Designed to exclude water applied in form of hose stream. To protect against stream of water during cleaning operations, etc. |
| NEMA 4X ① Watertight & Corrosion Resistant | Designed to exclude water applied in form of hose stream. To protect against stream of water during cleaning operations, etc. Corrosion Resistant. |
| NEMA 5 Dust Tight | Constructed so that dust will not enter enclosed case. Being replaced in some equipment by NEMA 12. |
| NEMA 6 Submersible | Intended to permit enclosed apparatus to be operated successfully when submerged in water under specified pressure and time. |
| NEMA 7 Hazardous Locations Class I – Air Break | Designed to meet application requirements of National Electrical Code for Class 1, Hazardous Locations (explosive atmospheres). Circuit interruption occurs in air. |
| NEMA 8 Hazardous Locations A, B, C or D Class II – Oil Immersed | Identical to NEMA 7 above, except the apparatus is immersed in oil. |
| NEMA 9 Hazardous Locations E, F or G Class II | Designed to meet application requirements of National Electrical Code for Class II Hazardous Locations (combustible dusts, etc.). |
| NEMA 10 Bureau of Mines Permissible | Meets requirements of U.S. Bureau of Mines. Suitable for use in coal mines. |
| NEMA 11 Dripproof Corrosion Resistant | Provides oil immersion of apparatus such that it is suitable for application where equipment is subject to acid or other corrosive fumes. |
| NEMA 12 Driptight, Dusttight | For use in those industries where it is desired to exclude dust, lint, fibers and flyings, or oil or Industrial coolant seepage. |


① Types available from ITT, Residential and Commercial Water.



Determining Flow Rates


FULL PIPE FLOW – CALCULATION OF DISCHARGE RATE USING HORIZONTAL OPEN DISCHARGE FORMULA

An L-shaped measuring square can be used to estimate flow capacity, using the chart below. As shown in illustration, place 4" side of square so that it hangs down and touches the water. The horizontal distance shown "A" is located in the first column of the chart and you read across to the pipe diameter (ID) to find the gallons per minute discharge rate.

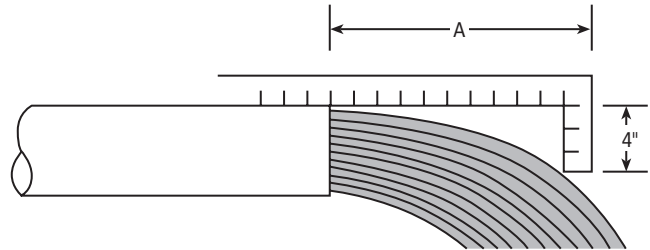

Example: A is 8" from a 4" ID pipe
= a discharge rate of 166 GPM.

PIPE NOT RUNNING FULL – CALCULATION OF DISCHARGE RATE USING AREA FACTOR METHOD

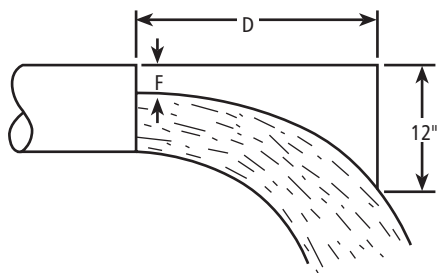

Flow From Horizontal Pipe (Not Full)

Flow (GPM) = A x D x 1.093 x F
 A = Area of pipe in square inches
 D = Horizontal distance in inches
 F = Effective area factor from chart
 Area of pipe equals inside Dia.² x 0.7854

Example: Pipe inside diameter = 10 in.
 D = 20 in.
 F = 2½ in.
 A = 10 x 10 x 0.7854 = 78.54 square in.

$$R\% = \frac{F}{D} = \frac{2\frac{1}{2}}{10} = 25\%$$

F = 0.805
 Flow = 78.54 x 20 x 1.039 x 0.805 = 1314 GPM

| Ratio F/D = R % | Eff. Area Factor F | Ratio F/D = R % | Eff. Area Factor F |
|--------------------|-----------------------|--------------------|-----------------------|
| 5 | 0.981 | 55 | 0.436 |
| 10 | 0.948 | 60 | 0.373 |
| 15 | 0.905 | 65 | 0.312 |
| 20 | 0.858 | 70 | 0.253 |
| 25 | 0.805 | 75 | 0.195 |
| 30 | 0.747 | 80 | 0.142 |
| 35 | 0.688 | 85 | 0.095 |
| 40 | 0.627 | 90 | 0.052 |
| 45 | 0.564 | 95 | 0.019 |
| 50 | 0.500 | 100 | 0.000 |

DISCHARGE RATE IN GALLONS PER MINUTE/NOMINAL PIPE SIZE (ID)

| Horizontal Dist. (A) Inches | Pipe Diameter | | | | | | | | | | | |
|-----------------------------------|---------------|------|------|------|------|------|------|-----|------|------|------|------|
| | 1" | 1¼" | 1½" | 2" | 2½" | 3" | 4" | 5" | 6" | 8" | 10" | 12" |
| 4 | 5.7 | 9.8 | 13.3 | 22.0 | 31.3 | 48.5 | 83.5 | | | | | |
| 5 | 7.1 | 12.2 | 16.6 | 27.5 | 39.0 | 61.0 | 104 | 163 | | | | |
| 6 | 8.5 | 14.7 | 20.0 | 33.0 | 47.0 | 73.0 | 125 | 195 | 285 | | | |
| 7 | 10.0 | 17.1 | 23.2 | 38.5 | 55.0 | 85.0 | 146 | 228 | 334 | 380 | | |
| 8 | 11.3 | 19.6 | 26.5 | 44.0 | 62.5 | 97.5 | 166 | 260 | 380 | 665 | 1060 | |
| 9 | 12.8 | 22.0 | 29.8 | 49.5 | 70.0 | 110 | 187 | 293 | 430 | 750 | 1190 | 1660 |
| 10 | 14.2 | 24.5 | 33.2 | 55.5 | 78.2 | 122 | 208 | 326 | 476 | 830 | 1330 | 1850 |
| 11 | 15.6 | 27.0 | 36.5 | 60.5 | 86.0 | 134 | 229 | 360 | 525 | 915 | 1460 | 2100 |
| 12 | 17.0 | 29.0 | 40.0 | 66.0 | 94.0 | 146 | 250 | 390 | 570 | 1000 | 1600 | 2220 |
| 13 | 18.5 | 31.5 | 43.0 | 71.5 | 102 | 158 | 270 | 425 | 620 | 1080 | 1730 | 2400 |
| 14 | 20.0 | 34.0 | 46.5 | 77.0 | 109 | 170 | 292 | 456 | 670 | 1160 | 1860 | 2590 |
| 15 | 21.3 | 36.3 | 50.0 | 82.5 | 117 | 183 | 312 | 490 | 710 | 1250 | 2000 | 2780 |
| 16 | 22.7 | 39.0 | 53.0 | 88.0 | 125 | 196 | 334 | 520 | 760 | 1330 | 2120 | 2960 |
| 17 | | 41.5 | 56.5 | 93.0 | 133 | 207 | 355 | 550 | 810 | 1410 | 2260 | 3140 |
| 18 | | | 60.0 | 99.0 | 144 | 220 | 375 | 590 | 860 | 1500 | 2390 | 3330 |
| 19 | | | | 110 | 148 | 232 | 395 | 620 | 910 | 1580 | 2520 | 3500 |
| 20 | | | | | 156 | 244 | 415 | 650 | 950 | 1660 | 2660 | 3700 |
| 21 | | | | | | 256 | 435 | 685 | 1000 | 1750 | 2800 | |
| 22 | | | | | | | 460 | 720 | 1050 | 1830 | 2920 | |
| 23 | | | | | | | | 750 | 1100 | 1910 | 3060 | |
| 24 | | | | | | | | | 1140 | 2000 | 3200 | |



Terms and Usable Formulas

The term "head" by itself is rather misleading. It is commonly taken to mean the difference in elevation between the suction level and the discharge level of the liquid being pumped. Although this is partially correct, it does not include all of the conditions that should be included to give an accurate description.

■ **Friction Head:**

The pressure expressed in lbs./sq. in. or feet of liquid needed to overcome the resistance to the flow in the pipe and fittings.

■ **Suction Lift:** Exists when the source of supply is below the center line of the pump.

■ **Suction Head:** Exists when the source of supply is above the center line of the pump.

■ **Static Suction Lift:** The vertical distance from the center line of the pump down to the free level of the liquid source.

■ **Static Suction Head:** The vertical distance from the center line of the pump up to the free level of the liquid source.

■ **Static Discharge Head:**

The vertical elevation from the center line of the pump to the point of free discharge.

■ **Dynamic Suction Lift:**

Includes static suction lift, friction head loss and velocity head.

■ **Dynamic Suction Head:** Includes static suction head minus friction head minus velocity head.

■ **Dynamic Discharge Head:** Includes static discharge head plus friction head plus velocity head.

■ **Total Dynamic Head:**

Includes the dynamic discharge head plus dynamic suction lift or minus dynamic suction head.

■ **Velocity Head:** The head needed to accelerate the liquid. Knowing the velocity of the liquid, the velocity head loss can be calculated by a simple formula $Head = V^2/2g$ in which g is acceleration due to gravity or 32.16 ft./sec. Although the velocity head loss is a factor in figuring the dynamic heads, the value is usually small and in most cases negligible. See table.

BASIC FORMULAS AND SYMBOLS

Formulas

$$GPM = \frac{Lb./Hr.}{500 \times Sp. Gr.}$$

$$H = \frac{2.31 \times psi}{Sp. Gr.}$$

$$H = \frac{1.134 \times In. Hg.}{Sp. Gr.}$$

$$H_v = \frac{V^2}{2g} = 0.155 V^2$$

$$V = \frac{GPM \times 0.321}{A} = \frac{GPM \times 0.409}{(I.D.)^2}$$

$$BHP = \frac{GPM \times H \times Sp. Gr.}{3960 \times Eff.}$$

$$Eff. = \frac{GPM \times H \times Sp. Gr.}{3960 \times BHP}$$

$$N_s = \frac{N\sqrt{GPM}}{H^{3/4}}$$

$$H = \frac{V^2}{2g}$$


Approximate Cost of Operating Electric Motors

| Motor HP | *Average kilowatts input or cost based on 1 cent per kilowatt hour | | Motor HP | *Av. kw input or cost per hr. based on 1 cent per kw hour |
|----------|--------------------------------------------------------------------|---------|----------|-----------------------------------------------------------|
| | 1 Phase | 3 Phase | | 3 Phase |
| 1/3 | .408 | | 20 | 16.9 |
| 1/2 | .535 | .520 | 25 | 20.8 |
| 3/4 | .760 | .768 | 30 | 26.0 |
| 1 | 1.00 | .960 | 40 | 33.2 |
| 1 1/2 | 1.50 | 1.41 | 50 | 41.3 |
| 2 | 2.00 | 1.82 | 60 | 49.5 |
| 3 | 2.95 | 2.70 | 75 | 61.5 |
| 5 | 4.65 | 4.50 | 100 | 81.5 |
| 7 1/2 | 6.90 | 6.75 | 125 | 102 |
| 10 | 9.30 | 9.00 | 150 | 122 |
| | | | 200 | 162 |

Symbols

- GPM = gallons per minute
- Lb. = pounds
- Hr. = hour
- Sp. Gr. = specific gravity
- H = head in feet
- psi = pounds per square inch
- In. Hg. = inches of mercury
- h_v = velocity head in feet
- V = velocity in feet per second
- g = 32.16 ft./sec.² (acceleration of gravity)

- A = area in square inches (πr²) (for a circle or pipe)
- ID = inside diameter in inches
- BHP = brake horsepower
- Eff. = pump efficiency expressed as a decimal
- N_s = specific speed
- N = speed in revolutions per minute
- D = impeller in inches




Terms and Usable Formulas

BASIC FORMULAS AND SYMBOLS

Temperature conversion

$$\text{DEG. C} = (\text{DEG. F} - 32) \times .555$$

$$\text{DEG. F} = (\text{DEG. C} \times 1.8) + 32$$



CIRCLE

Area of a Circle

A = area; C = circumference. D = diameter

$$A = \pi r^2; \pi = 3.14 \quad r = \text{radius}$$

$$C = 2\pi r$$

$$\text{Water Horsepower} = \frac{\text{GPM} \times 8.33 \times \text{Head}}{33000} = \frac{\text{GPM} \times \text{Head}}{3960}$$

Where:

GPM = Gallons per Minute
8.33 = Pounds of water per gallon
33000 = Ft. Lbs. per minute in one horsepower
Head = Difference in energy head in feet (field head).

$$\text{Laboratory BHP} = \frac{\text{Head} \times \text{GPM} \times \text{Sp. Gr.}}{3960 \times \text{Eff.}}$$

$$\text{Field BHP} = \text{Laboratory BHP} + \text{Shaft Loss}$$

$$\text{Total BHP} = \text{Field BHP} + \text{Thrust Bearing Loss}$$

Where:

GPM = Gallons per Minute
Head = Lab. Head (including column loss)
Eff. = Lab. Eff. of Pump Bowls
Shaft Loss = HP loss due to mechanical friction of lineshaft bearings
Thrust Bearing Loss = HP Loss in driver thrust bearings
 (See (1) below under Misc.)

$$\text{Input Horsepower} = \frac{\text{Total BHP}}{\text{Motor Eff.}}$$

Motor Eff. from Motor mfg. (as a decimal)

$$\text{Field Efficiency} = \frac{\text{Water Horsepower}}{\text{Total BHP}}$$

Water HP as determined above
 Total BHP as determined above


$$\text{Overall Plant Efficiency} = \frac{\text{Water Horsepower}}{\text{Input Horsepower}}$$

(See (2) below under Misc.)
 Water HP as determined above
 Input HP as determined above


| | | |
|----------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------|
| Electrical | $\text{Input Horsepower} = \frac{\text{BHP}}{\text{Mot. Eff.}} = \frac{4.826 \times \text{K} \times \text{M} \times \text{R}}{\text{T}} = \frac{1.732 \times \text{E} \times \text{I} \times \text{PF}}{746}$ | |
| | <p>BHP = Brake Horsepower as determined above Mot. Eff. = Rated Motor Efficiency K = Power Company Meter Constant M = Power Company Meter Multiplier, or Ratio of Current and Potential Transformers connected with meter R = Revolutions of meter disk T = Time in Sec. for R E = Voltage per Leg applied to motor I = Amperes per Leg applied to motor PF = Power factor of motor 1.732 = Factor for 3-phase motors. This reduces to 1 for single phase motors</p> | |
| | $\text{Kilowatt input to Motor} = \frac{.746 \times \text{I.H.P.}}{1000} = \frac{1.732 \times \text{E} \times \text{I} \times \text{PF}}{1000}$ | $\text{KW-Hrs. Per 1000 Gallons of Cold Water Pumped Per Hour} = \frac{\text{HD in ft.} \times 0.00315}{\text{Pump Eff.} \times \text{Mot. Eff.}}$ |
| Miscellaneous | <p>(1) Thrust Bearing Loss = .0075 HP per 100 RPM per 1000 lbs. thrust.* (2) Overall Plant Efficiency sometimes referred to as "Wire to Water" Efficiency *Thrust (in lbs.) = (thrust constant (k) laboratory head) + (setting in feet x shaft wt. per ft.) Note: Obtain thrust constant from curve sheets</p> | |
| | $\text{Discharge Head (in feet of fluid pumped)} = \frac{\text{Discharge Pressure (psi)} \times 2.31}{\text{Sp. Gr. of Fluid Pumped}}$ | |



Sump Pump Typical Installations

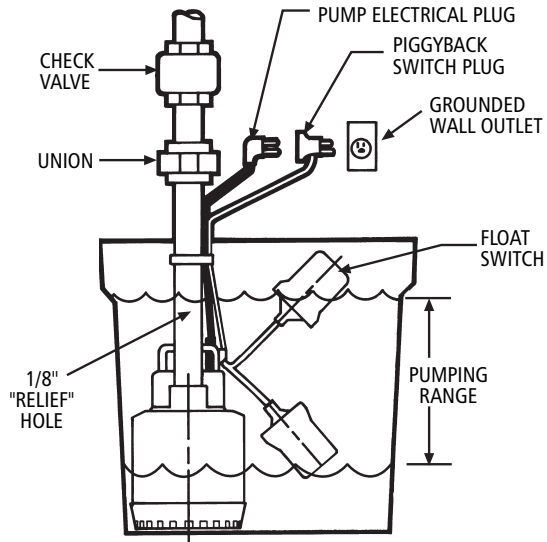


Typical Pump Installation in Sump

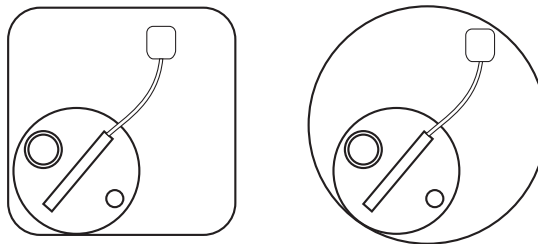


Suggested Pump Positioning in Sump



Effluent and Sewage Pumps Typical Installations

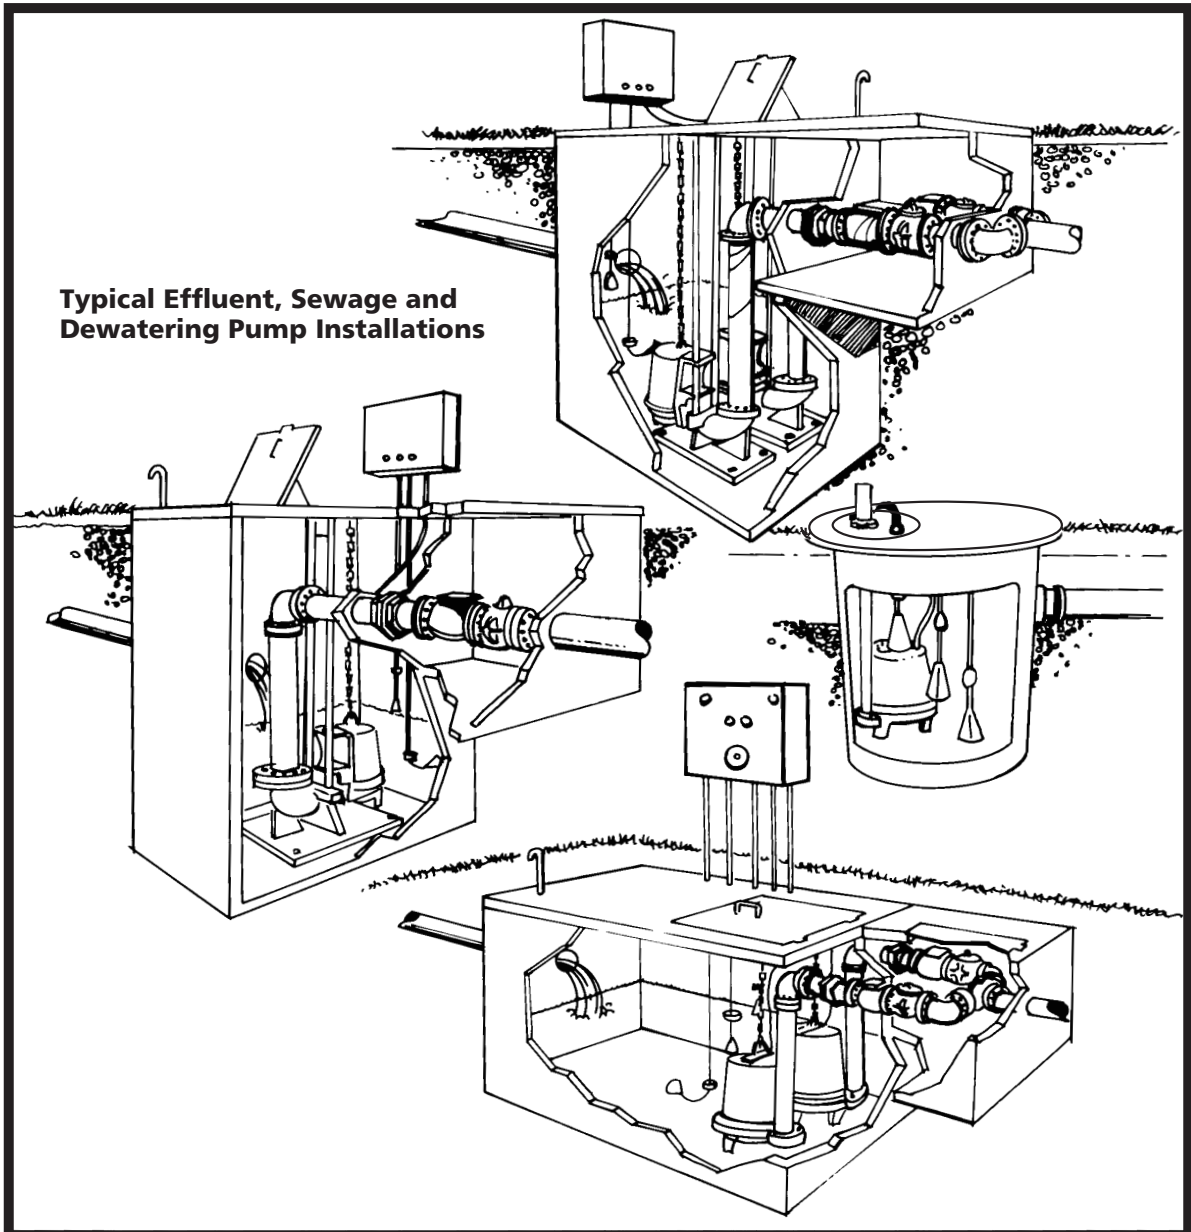



Variable Speed Drives

WASTEWATER PUMPS AND VARIABLE SPEED DRIVES

It is acceptable and increasingly more common to operate three-phase wastewater pumps using VFD's or variable frequency (speed) drives. We have successfully tested and operated all our premium cast iron construction, three-phase pumps between 30 and 60 hertz operation. The pumps should never be operated below 30 hertz (the VFD must be programmed for a minimum speed of 30 hertz to prevent continuous operation) or above 60 hertz due to increased motor HP loading, higher amperage and the resultant heat rise (see HP in 70 hertz Performance Multipliers).

The "Affinity Laws" state that for a given pump, the capacity will vary directly with a change in speed, the head will vary as the square of the speed change and the required power will vary as the cube of the speed change. (The Affinity Law formulas can be found in the Water Products Technical Manual, TTECHWP). The Performance Multiplier Chart provides shortcut multipliers that eliminate having to solve the Affinity Law equations.

To calculate a pump's total performance range when using a VFD, use the 30 hertz data to create a minimum speed curve, the VFD controlled pump should always be operated between 30 hertz and the published 60 hertz curve. Where it operates at any given moment is irrelevant.

Q_1 , H_1 and BHP_1 are determined at the pump's rated speed N_1 (rpm).

Q_2 , H_2 and BHP_2 are determined at speed N_2 (rpm).

Use the multipliers with a minimum of 3 data points taken from any standard, 60 Hz curve to determine the performance of that pump at a new speed.


| Hertz | Performance Multipliers | |
|--------------------------------------------|-------------------------|-----------------------------|
| 70 – $Q_2 = Q_1 \times 1.17$ | $H_2 = H_1 \times 1.37$ | $BHP_2 = BHP_1 \times 1.6$ |
| 60 – Use the standard published curve data | | |
| 50 – $Q_2 = Q_1 \times .83$ | $H_2 = H_1 \times .69$ | $BHP_2 = BHP_1 \times .57$ |
| 40 – $Q_2 = Q_1 \times .67$ | $H_2 = H_1 \times .45$ | $BHP_2 = BHP_1 \times .3$ |
| 30 – $Q_2 = Q_1 \times .5$ | $H_2 = H_1 \times .25$ | $BHP_2 = BHP_1 \times .125$ |

An example would be, solve for Q_2 , H_2 and BHP_2 for a 60 Hz pump that produces 100 gpm (Q_1) @ 100' tdh (H_1) using 5 hp (BHP_1) when it is operated at 30 Hz :

Answers: 100 gpm $\times .5 = 50$ gpm, 100' TDH $\times .25 = 25'$ TDH and 5 hp $\times .125 = .63$ hp.

VFD's save energy while reducing the thrust on the motor bearings and the starting torque on the shaft and impeller.

Contact Customer Service for details, pricing and availability of our full line of VFD products.





ITT

Wastewater

Duplex Single Phase Wiring Diagram – D10020

NOTE: The standard panels shown in this book are not designed to be used with pumps requiring external capacitors. See the catalog for panels with built-in capacitor packs.

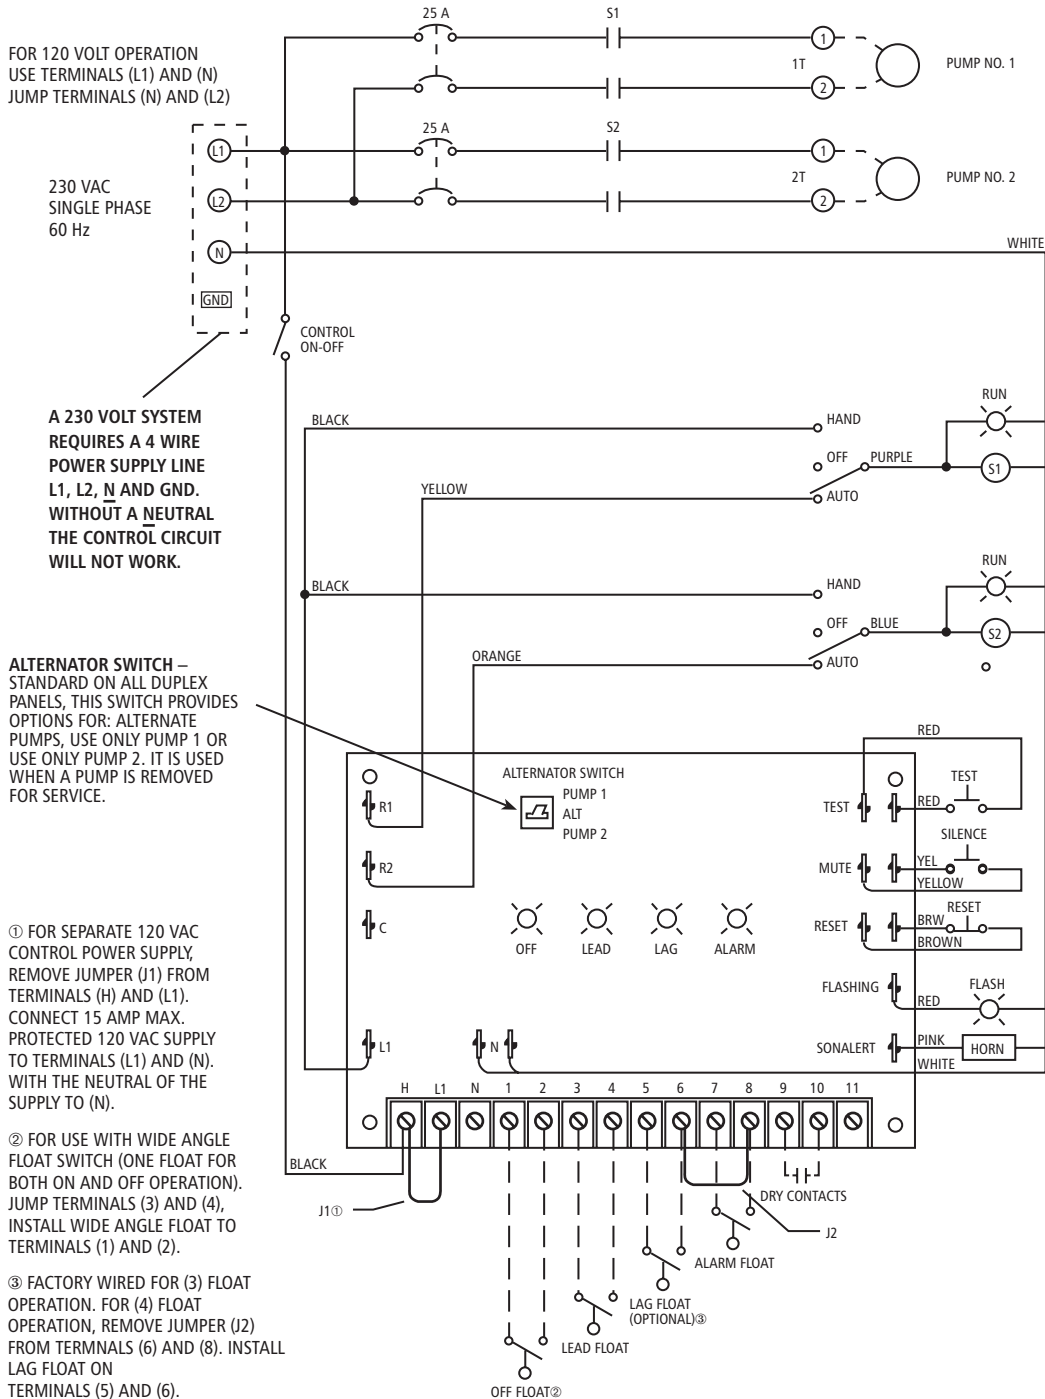




ITT


Wastewater

Duplex Single Phase Panel Layout – D10020

- ① FOR SEPARATE 120 VAC CONTROL POWER SUPPLY, REMOVE JUMPER (J1) FROM TERMINALS (H) AND (L1). CONNECT 15 AMP MAX. PROTECTED 120 VAC SUPPLY TO TERMINALS (L1) AND (N). WITH THE NEUTRAL OF THE SUPPLY TO (N).
- ② FOR 120 VAC OPERATION, USE TERMINALS L1 AND N, JUMP TERMINALS L2 AND N.
- ③ FACTORY WIRING FOR (3) FLOAT OPERATION. FOR (4) FLOAT OPERATION, REMOVE JUMPER (J2) FROM TERMINALS (6) AND (8). INSTALL LAG FLOAT ON TERMINALS (5) AND (6).

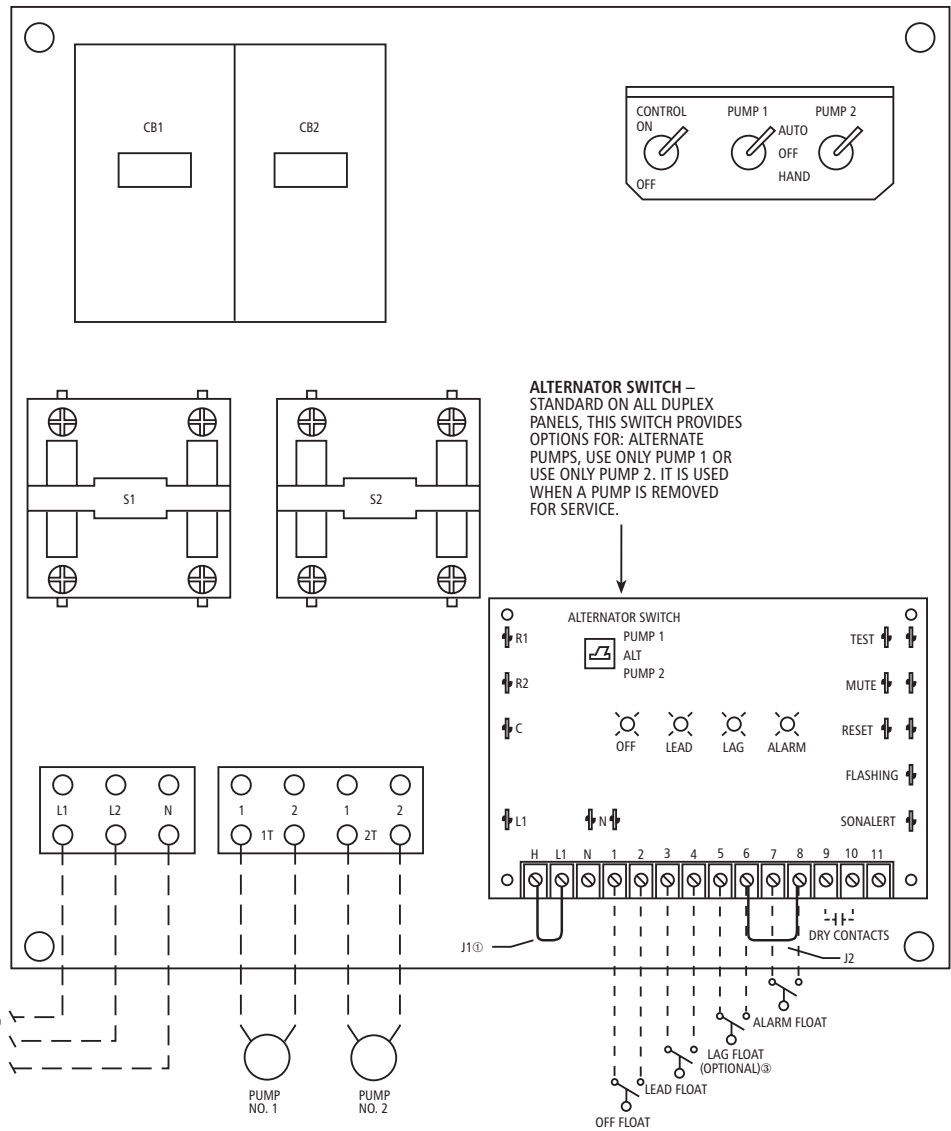


NOTE: Panel is not to be used with pumps that do not include capacitors.




ITT

Wastewater

Duplex Three Phase Wiring Diagram - D3

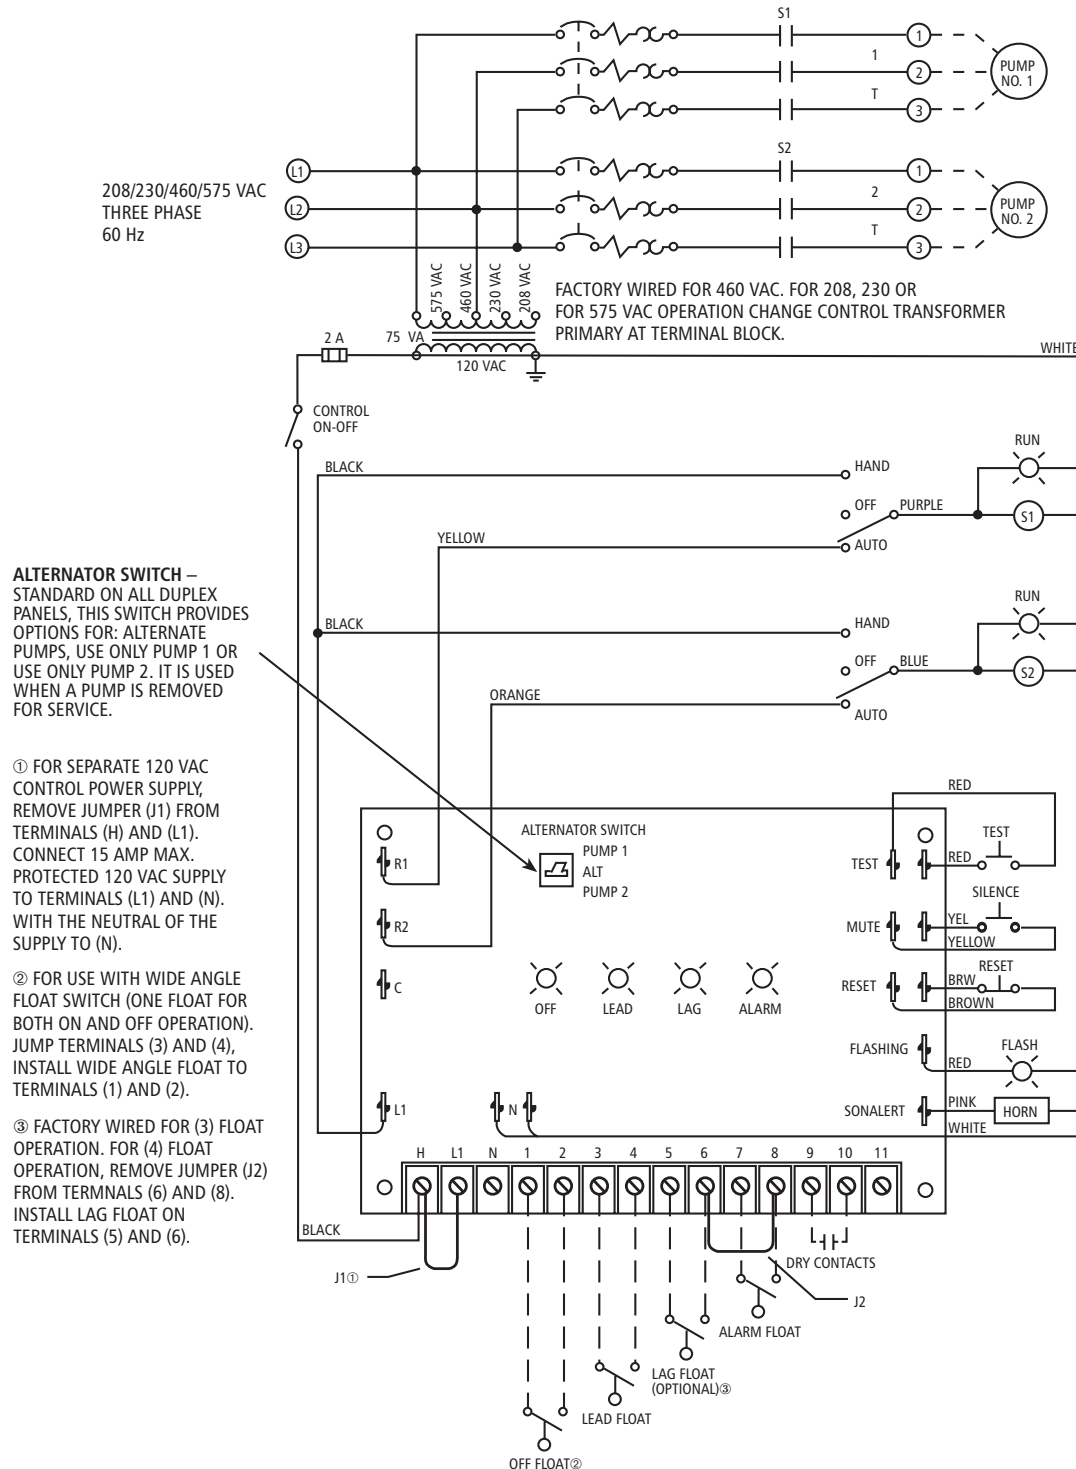




ITT

Wastewater

Duplex Three Phase Panel Layout – D3 — — — —

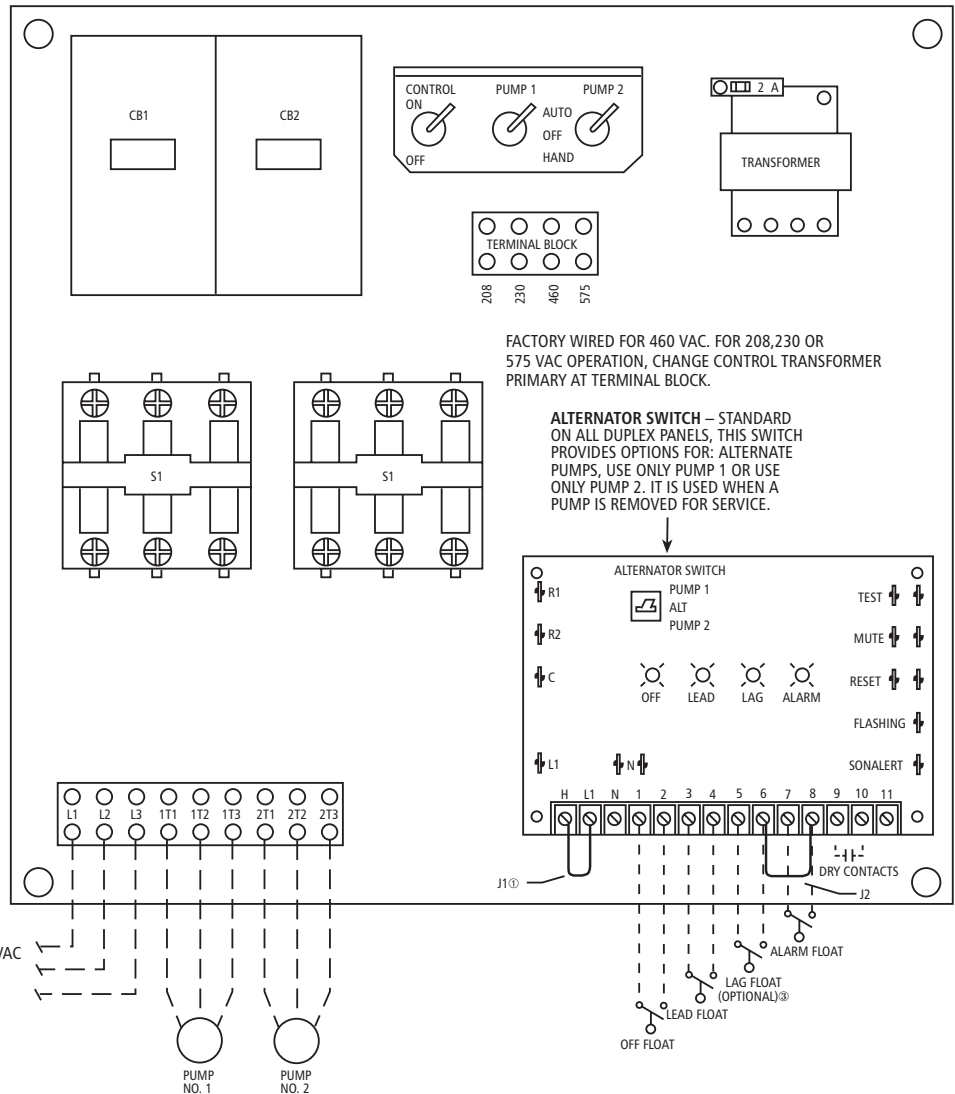


FACTORY WIRING FOR 460 VAC. FOR 208, 230 OR 575 VAC OPERATION, CHANGE CONTROL TRANSFORMER PRIMARY AT TERMINAL BLOCK.

ALTERNATOR SWITCH – STANDARD ON ALL DUPLEX PANELS, THIS SWITCH PROVIDES OPTIONS FOR: ALTERNATE PUMPS, USE ONLY PUMP 1 OR USE ONLY PUMP 2. IT IS USED WHEN A PUMP IS REMOVED FOR SERVICE.

① FOR SEPARATE 120 VAC CONTROL POWER SUPPLY, REMOVE JUMPER (J1) FROM TERMINALS (H) AND (L1). CONNECT 15 AMP MAX. PROTECTED 120 VAC SUPPLY TO TERMINALS (L1) AND (N). WITH THE NEUTRAL OF THE SUPPLY TO (N).

③ FACTORY WIRING FOR (3) FLOAT OPERATION. FOR (4) FLOAT OPERATION, REMOVE JUMPER (J2) FROM TERMINALS (6) AND (8). INSTALL LAG FLOAT ON TERMINALS (5) AND (6).

208/230/460/575 VAC
THREE PHASE
60 Hz




ITT

Wastewater


Simplex Single Phase Wiring Diagram – S10020 Before October 1, 2003

NOTE: The standard panels shown in this book are not designed to be used with pumps requiring external capacitors. See the catalog for panels with built-in capacitor packs.

115/230 VAC (FOR 115 VAC, USE TERMINALS L1 AND N, JUMP L2 AND N).
SINGLE PHASE, 60 Hz

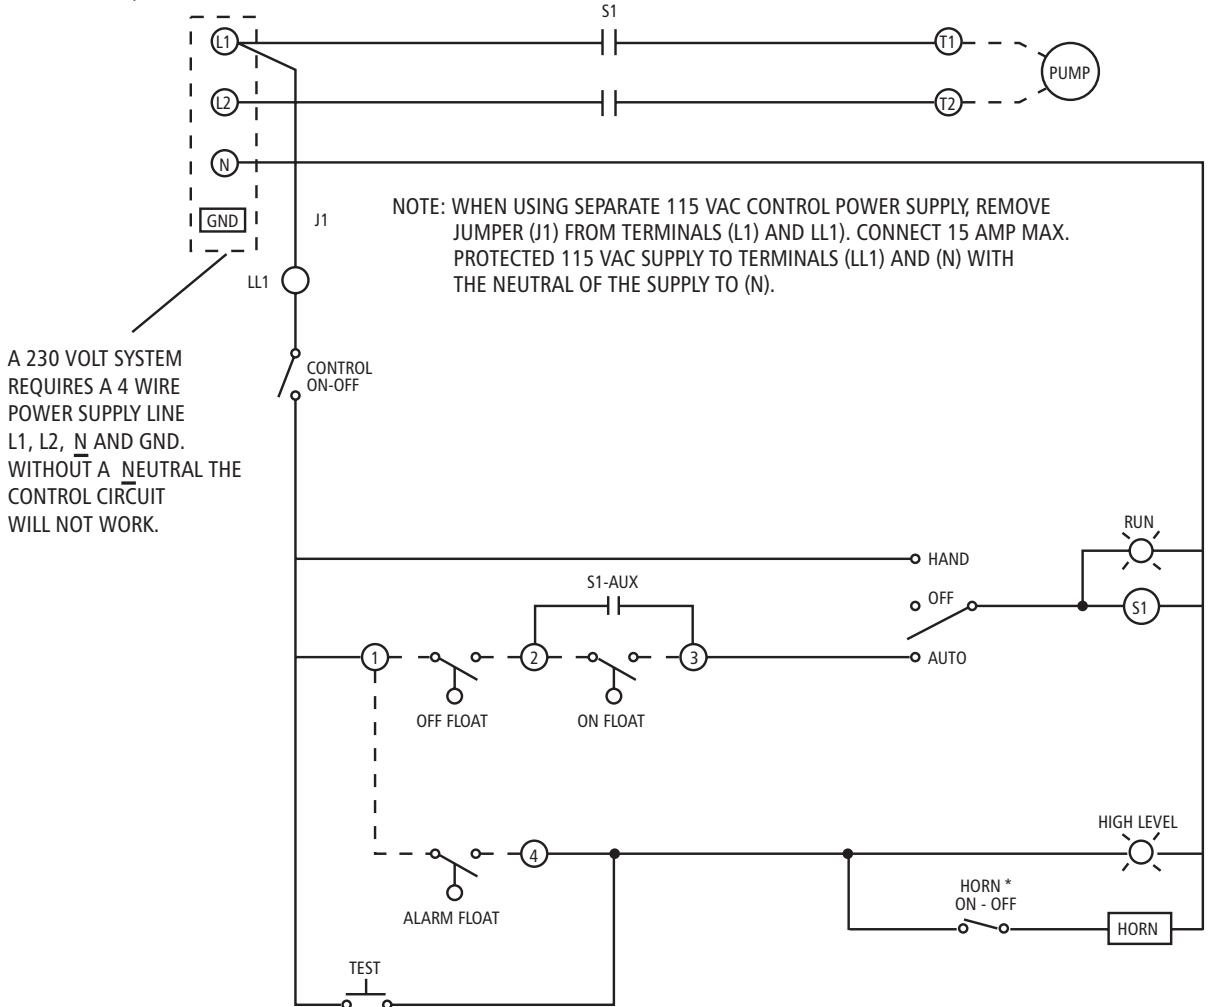

*NOTE: THE HORN ON/OFF SELECTOR SWITCH MUST BE PLACED BACK INTO THE (ON) POSITION AFTER THE ALARM CONDITION HAS BEEN CORRECTED IN ORDER TO MAINTAIN THE AUDIO ALARM ANNUNCIATION




ITT

Wastewater

Simplex Single Phase Wiring Diagram – S10020 After October 1, 2003

115/230 VAC (FOR 115 VAC, USE TERMINALS L1 AND N, JUMP L2 AND N.)
SINGLE PHASE 60 HZ

PROVIDE DISCONNECT AND
BRANCH CIRCUIT PROTECTION
PER NEC CODE

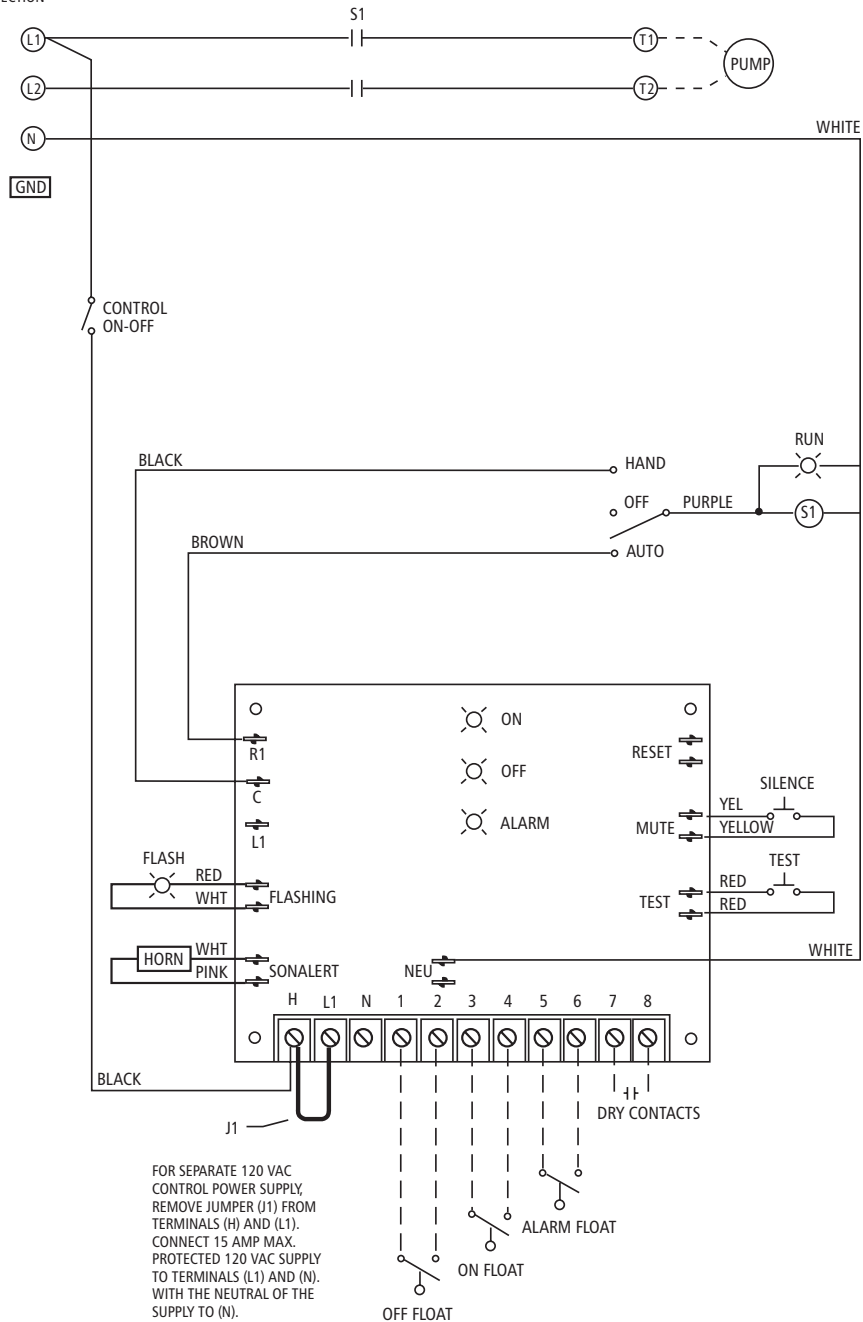


FOR SEPARATE 120 VAC
CONTROL POWER SUPPLY,
REMOVE JUMPER (J1) FROM
TERMINALS (H) AND (L1).
CONNECT 15 AMP MAX.
PROTECTED 120 VAC SUPPLY
TO TERMINALS (L1) AND (N).
WITH THE NEUTRAL OF THE
SUPPLY TO (N).


FOR USE WITH WIDE ANGLE FLOAT SWITCH (ONE FLOAT FOR BOTH ON AND OFF OPERATION).
JUMP TERMINALS (3) AND (4), INSTALL WIDE ANGLE FLOAT TO TERMINALS (1) AND (2).





Switch Diagrams

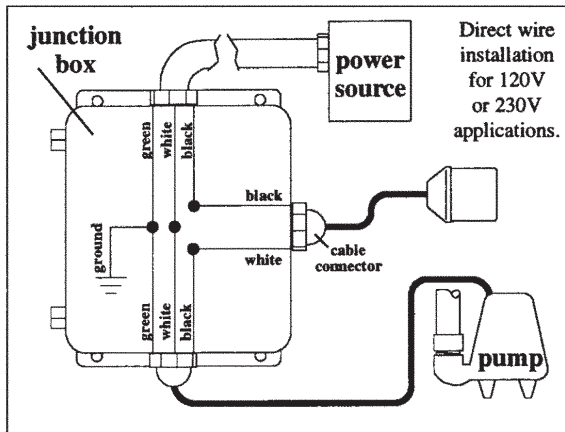


Pumpmaster and Pumpmaster Plus - Hard Wired

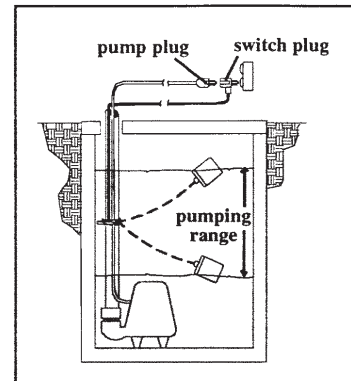


Determining the Pumping Range

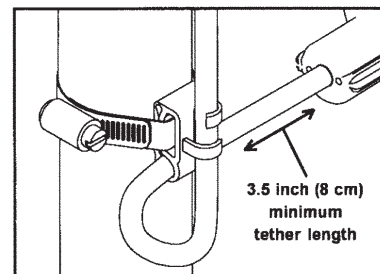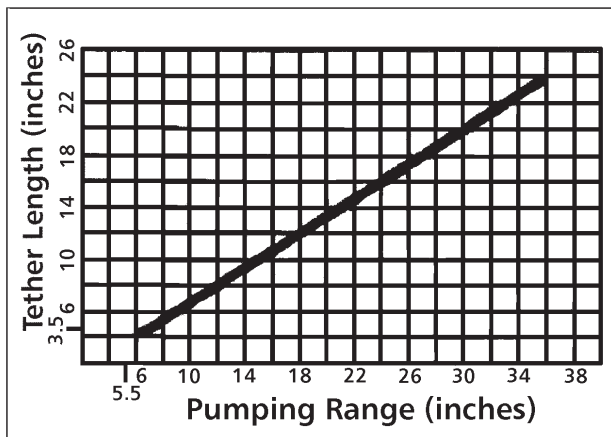

Mounting Strap

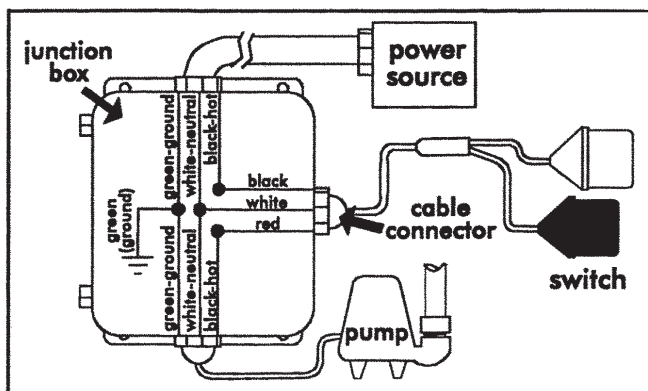

Double Float - Hard Wired

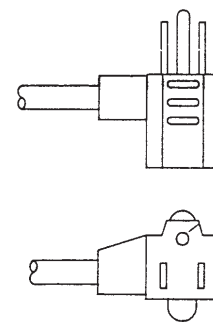

Piggyback Plug



Sewage Control Panels and Switches

There are two basic switches used in sewage and effluent systems. Single-action or narrow-angle float switches perform one function (on or off). They operate over a range of 15°. Wide-angle, or double-action float and diaphragm switches perform two functions (on *and* off). Wide-angle float switches operate over a 90° range and diaphragm switches on a 6" rise in water level.

Control panel wiring diagrams refer to 3 float and 4 float systems, this terminology refers to the use of single-action switches. The following chart shows how many of either type switch to use with different control panels.

Duplex Control Panels

Typical Duplex panels use the following switch set-ups depending on the switch type you use. Most Duplex control panels have a standard high level alarm circuit with a flashing light, most have a horn or bell. Once it turns On - the alarm must be manually reset (turned off) on Duplex panels.

Using a Single-action or Narrow-angle Switch requires:

Three Float Panel Wiring

| | |
|-----------|---------------------|
| #1 Bottom | Pumps Off |
| #2 Middle | 1st Pump On |
| #3 Top | 2nd Pump & Alarm On |

Four Float Panel Wiring

| | |
|-----------|-------------|
| #1 Bottom | Pumps Off |
| #2 2nd | 1st Pump On |
| #3 3rd | 2nd Pump On |
| #4 Top | Alarm On |

Using Double-Action or Wide-Angle Switches; A2D23W, A2E21, A2E22, A2E23, A2D11, A2D31 or A2S23 requires:

Three Float Panel Wiring

| | |
|-----------|-----------------------|
| #1 Bottom | 1st Pump On/Both Off |
| #2 Top | 2nd Pump and Alarm On |

Four Float Panel Wiring

| | |
|-----------|----------------------|
| #1 Bottom | 1st Pump On/Both Off |
| #2 Middle | 2nd Pump On |
| #3 Top | Alarm On |

Simplex Control Panels

Only some Simplex panels have alarms. This is why the switch quantity requirements vary by simplex panel model. All of our SES panels have high level alarms.

Using a Single-action or Narrow-angle Switch requires:

Simplex Panel with Alarm

| | |
|-----------|--------------|
| #1 Bottom | Pump Off |
| #2 Middle | Pump On |
| #3 Top | Alarm On/Off |

Simplex Panel with No Alarm

| | |
|-----------|----------|
| #1 Bottom | Pump Off |
| #2 Top | Pump On |

Using Double-Action or Wide-angle Switches requires:


Simplex Panel with Alarm

| | |
|-----------|--------------|
| #1 Bottom | Pump On/Off |
| #2 Top | Alarm On/Off |

Simplex Panel with No Alarm

| | |
|-----------|-------------|
| #1 Bottom | Pump On/Off |
|-----------|-------------|

NOTE: 1st pump may also be referred to as "Lead" pump, 2nd pump may be called "Lag" pump.



ITT

Wastewater

We sell and stock a complete line of wastewater float switches. The most up-to-date information is found in the wastewater catalog Electrical Section. The switch bulletin is coded as BCPFS, i.e. Bulletin CentriPro Float Switches.


It may be found on our websites:

www.goulds.com

www.redjacketwaterproducts.com

www.centripro.com

www.bellgossett.com



ITT

Wastewater

Goulds Pumps

www.goulds.com

Red Jacket Water Products

www.redjacketwaterproducts.com

Bell & Gossett

www.bellgossett.com

CentriPro

www.centripro.com

Goulds Pumps, Red Jacket Water Products, Bell & Gossett, CentriPro and the ITT Engineered Blocks Symbol are registered trademarks and tradenames of ITT Corporation.

SPECIFICATIONS ARE SUBJECT TO CHANGE WITHOUT NOTICE.

TTECHS R1 March, 2008

© 2008 ITT Corporation

Engineered for life